
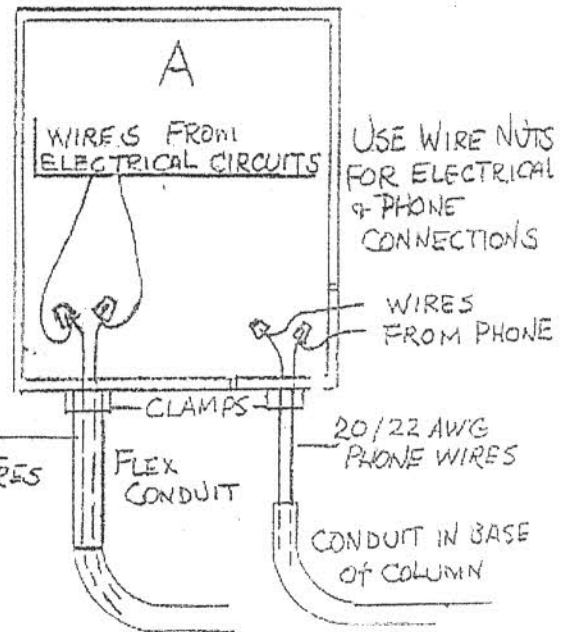
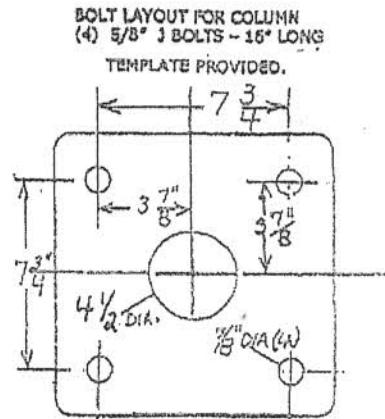


PLC 9A LED ALL CAMPUS ALERT INSTALLATION

POWER CONSUMPTION
 400 WATTS – 120 VAC
 500 WATTS – WITH HEATER

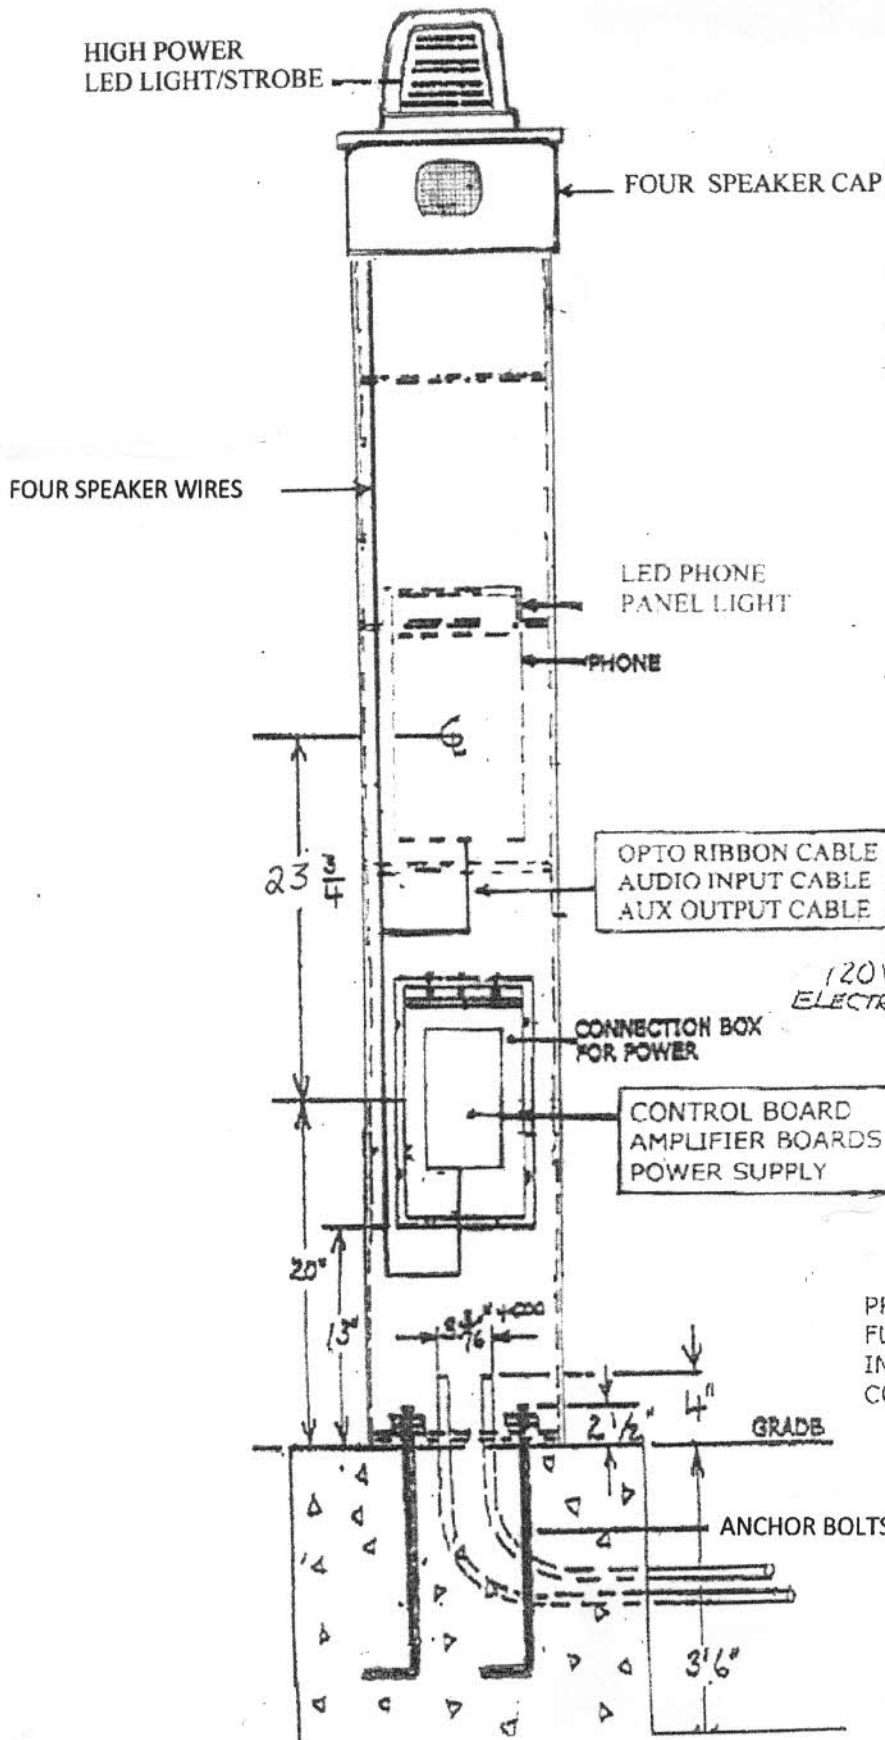

PROVIDE ABOUT 18" LENGTH OF PVC COATED FLEXIBLE CONDUIT FROM ELECTRICAL CONDUIT IN BASE TO CONNECTION BOX IN COLUMN. COLUMN IS PRE-WIRED.

RAMTEL CORP.
 115 RAILROAD AVE.
 Johnston, ri 02919
 401-231-3340

20" SQ. CONCRETE COLUMN BASE SHALL BE SURROUNDED BY UNDISTURBED SOIL OR BACK FILL COMPACTED TO 95% DENSITY OF SURROUNDING UNDISTURBED SOIL.