
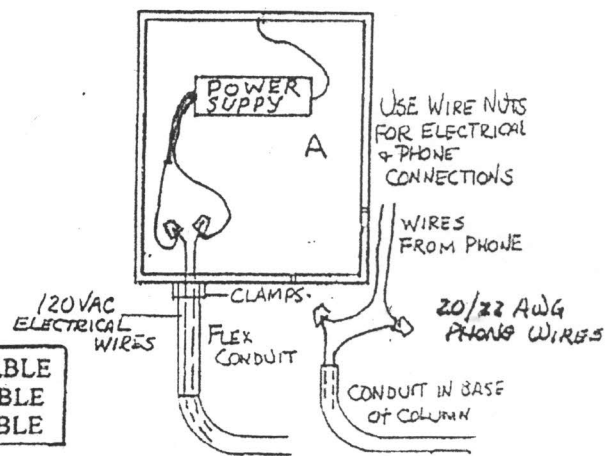
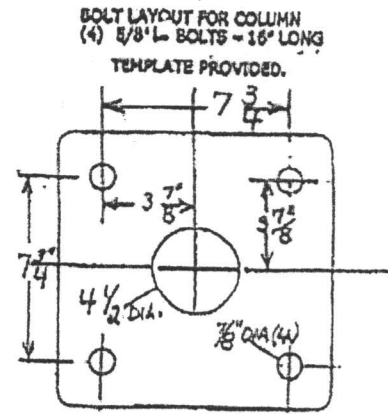


PLC 8A LED ALL CAMPUS ALERT INSTALLATION

POWER CONSUMPTION
 400 WATTS - 120 VAC
 500 WATTS - WITH HEATER

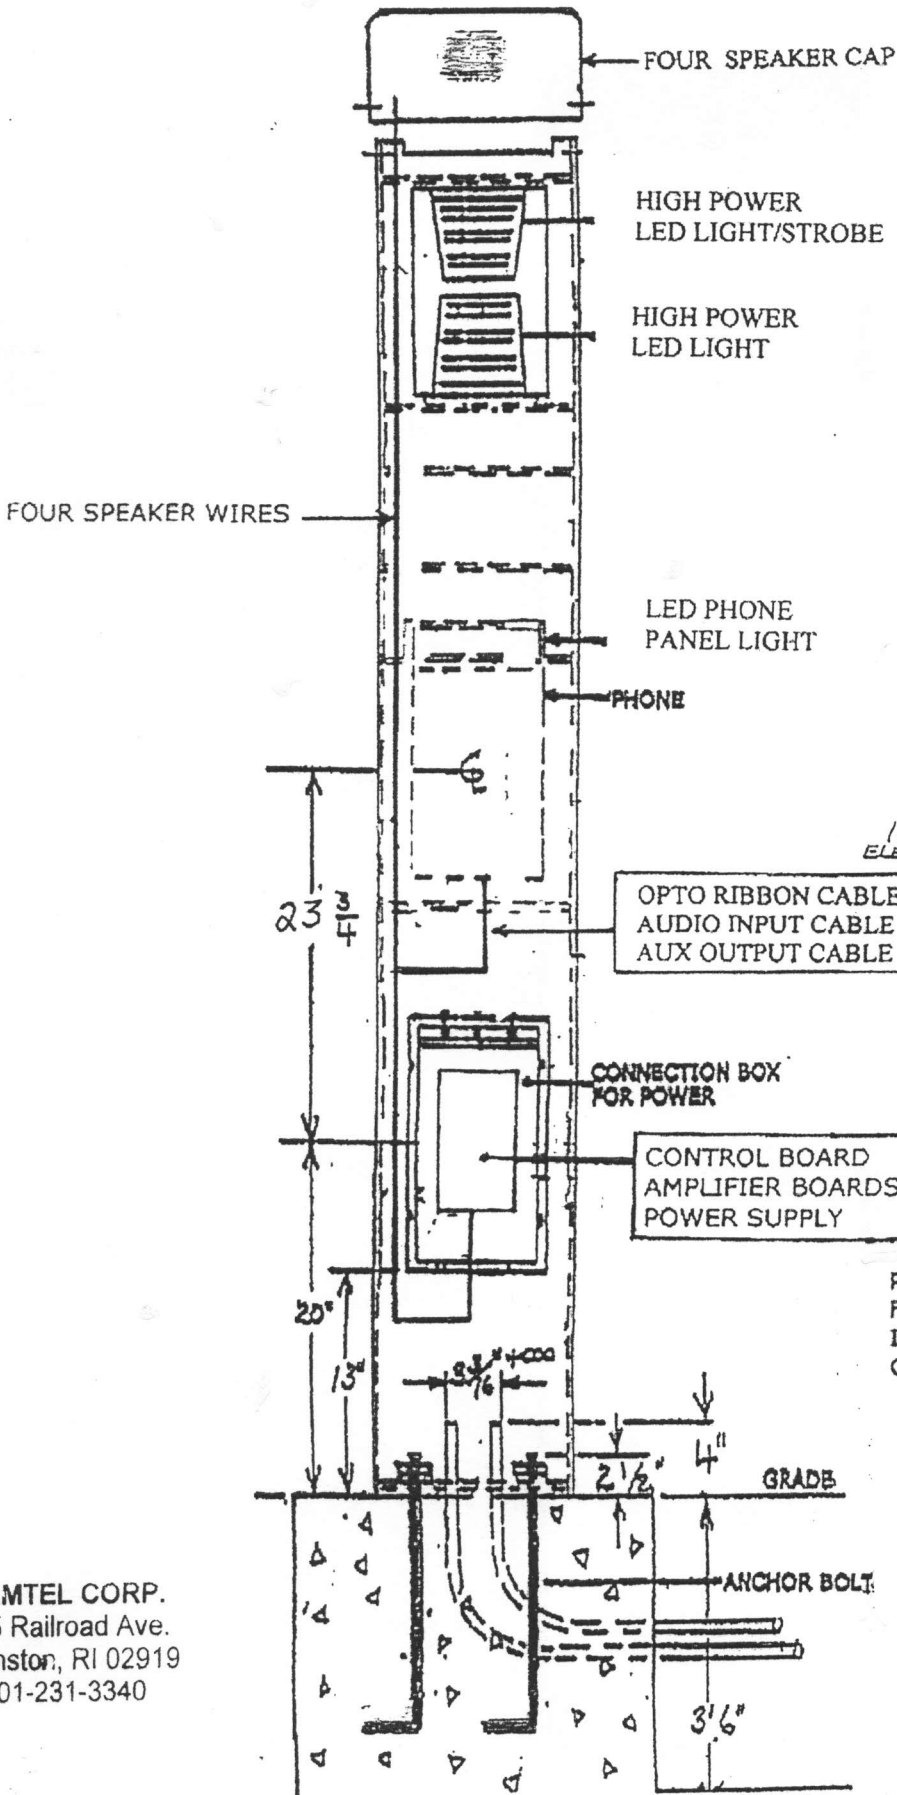

11" Sq. S.S. COLUMN

PROVIDE ABOUT 18" LENGTH OF PVC COATED FLEXIBLE CONDUIT FROM ELECTRICAL CONDUIT IN BASE TO CONNECTION BOX IN COLUMN. COLUMN IS PRE-WIRED.

20" SQ. CONCRETE COLUMN BASE SHALL BE SURROUNDED BY UNDISTURBED SOIL OR BACK FILL COMPACTED TO 95% DENSITY OF SURROUNDING UNDISTURBED SOIL.

RAMTEL CORP.
 115 Railroad Ave.
 Johnston, RI 02919
 401-231-3340