



PLC 10A LED ALL CAMPUS ALERT INSTALLATION


POWER CONSUMPTION
 400 WATTS - 120 VAC
 500 WATTS - WITH HEATER

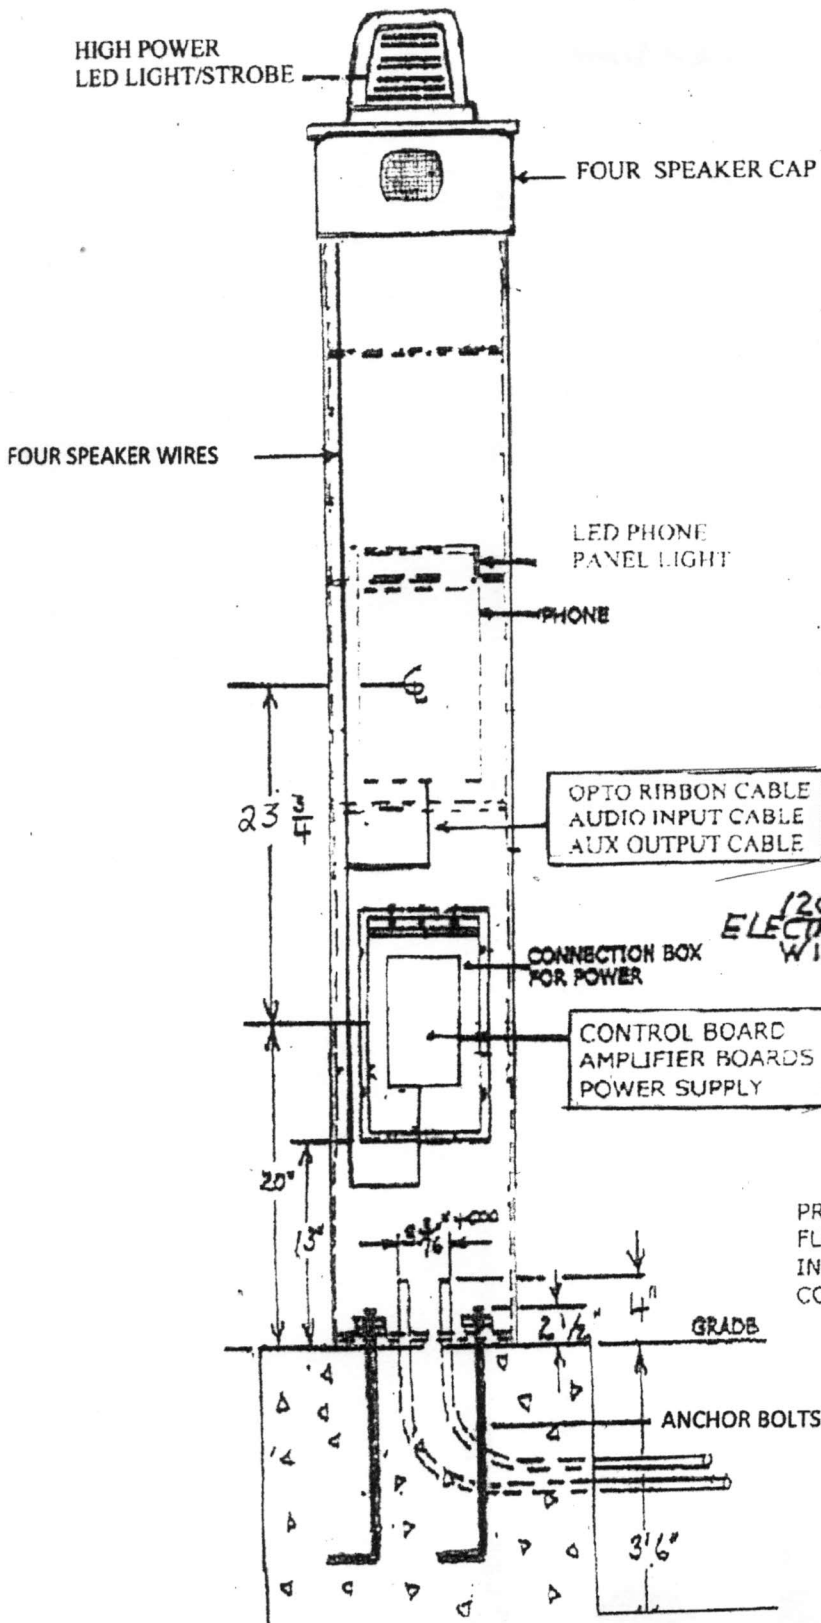

BOLT LAYOUT FOR COLUMN
 (4) 5/8" L BOLTS x 16" LONG

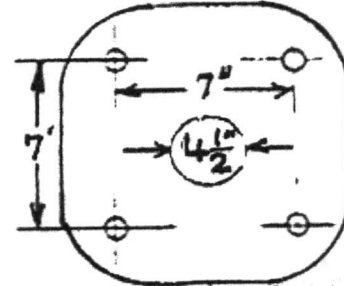

TEMPLATE PROVIDED

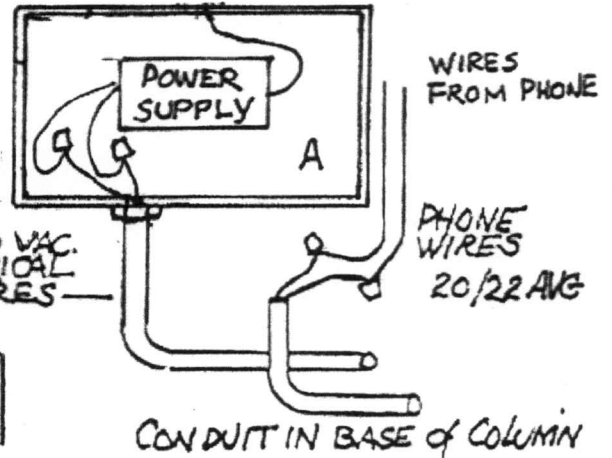

PROVIDE ABOUT 18" LENGTH OF PVC COATED FLEXIBLE CONDUIT FROM ELECTRICAL CONDUIT IN BASE TO CONNECTION BOX IN COLUMN. COLUMN IS PRE-WIRED.

RAMTEL CORP.
 115 RAILROAD AVE.
 Johnston, RI 02919
 401-231-3340

20" SQ. CONCRETE COLUMN
 BASE SHALL BE SURROUNDED
 BY UNDISTURBED SOIL OR
 BACK FILL COMPACTED TO
 95% DENSITY OF SURROUNDING
 UNDISTURBED SOIL.